


Parts List		
ITEM	QTY	PART NUMBER
1	1	Manway 24 in
2	2	Horiz Lifting Lug
3	2	Vertical Lifting Lug
4	4	ANSI/ASME B16.15 Cast Coupling - Class 125 2
5	1	6 in 150 lb fitting
6	3	3 in 150 lb fitting
7	1	ANSI/ASME B16.15 Cast Coupling - Class 125 3
8	4	tiedown lug
9	2	8in 150lb fitting
10	2	ASME B16.11 Coupling Threaded - Class 3000 1 1/2 x 1 1/2
11	1	Gooseneck Vent
12	1	8 in T.O.E. Emergency Vent
13	1	ASME B16.11 Coupling Threaded - Class 3000 1/2 x 1/2
14	1	29000 gallon tank

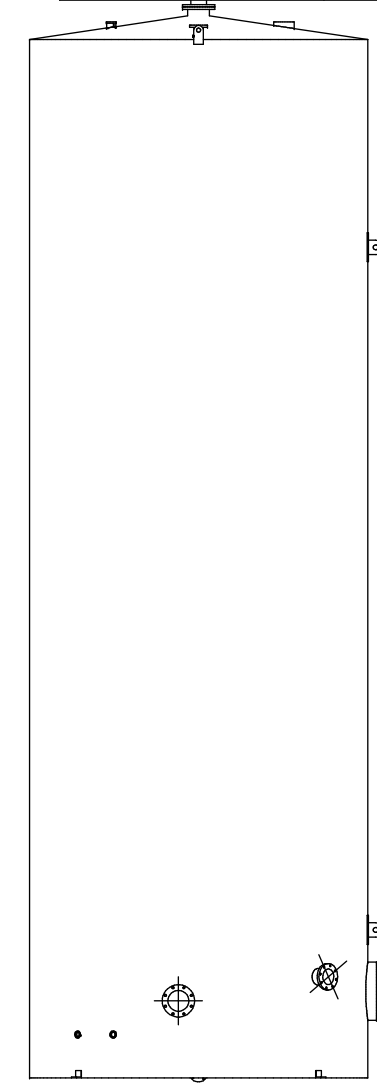

VIEW A-A
SCALE 1/80

1. TANK IS TO BE FABRICATED IN ACCORDANCE WITH UL 142 SPECIFICATIONS FOR VERTICAL ABOVEGROUND STORAGE TANKS.
2. TANK IS TO BE CONSTRUCTED OF MILD STEEL
3. UNLESS OTHERWISE SPECIFIED, ALL FITTINGS SHALL BE F.N.P.T. FULL COUPLINGS
4. AFTER COMPLETING TANK, TEST WITH 1 1/2 TO 2 1/2 PSIG AIR PRESSURE AND APPLY LEAK DETECTION SOLUTION TO ALL WELDS. REPAIR ANY LEAKS, AND RE-TEST.
5. TANK EXTERIOR IS TO BE PRIMED RED OXIDE AND FINISH PAINTED ALUMINUM.
6. All flanges to be "2 holed"

REVISION LEVEL	REVISION DESCRIPTION	REVISION BY	REVISION DATE
		James Reberneck	
DO NOT SCALE		AGRI PROCESS INNOVATIONS	
TOLERANCES ON DIMENSIONS		DRAWING TITLE	
DECIMALS ± 1/16"	ANGLES ± 0°	Tank 29000 gal	
DRWN BY	DATE	PROJECT NAME	
JNR	12/22/2006	API Tank	
APVD BY	SCALE	PAGE	SHEET
X	X	1 OF 1	B
PROJECT #	SCALE	PAGE	DRAWING No.
X	X	1 OF 1	API 1522