


# Heat Exchanger Design, Inc.

P. O. Box 524

Indianapolis, IN 46206-0524 USA

Phone: (317)686-9000 • Fax: (317)686-9100

---




## Manufacturer's Equipment Record Book

Customer: Range Fuels Soperton Plant, LLC

Purchase Order #: SOP10644

Item #: 41-E-112

Work Order #: 4017C

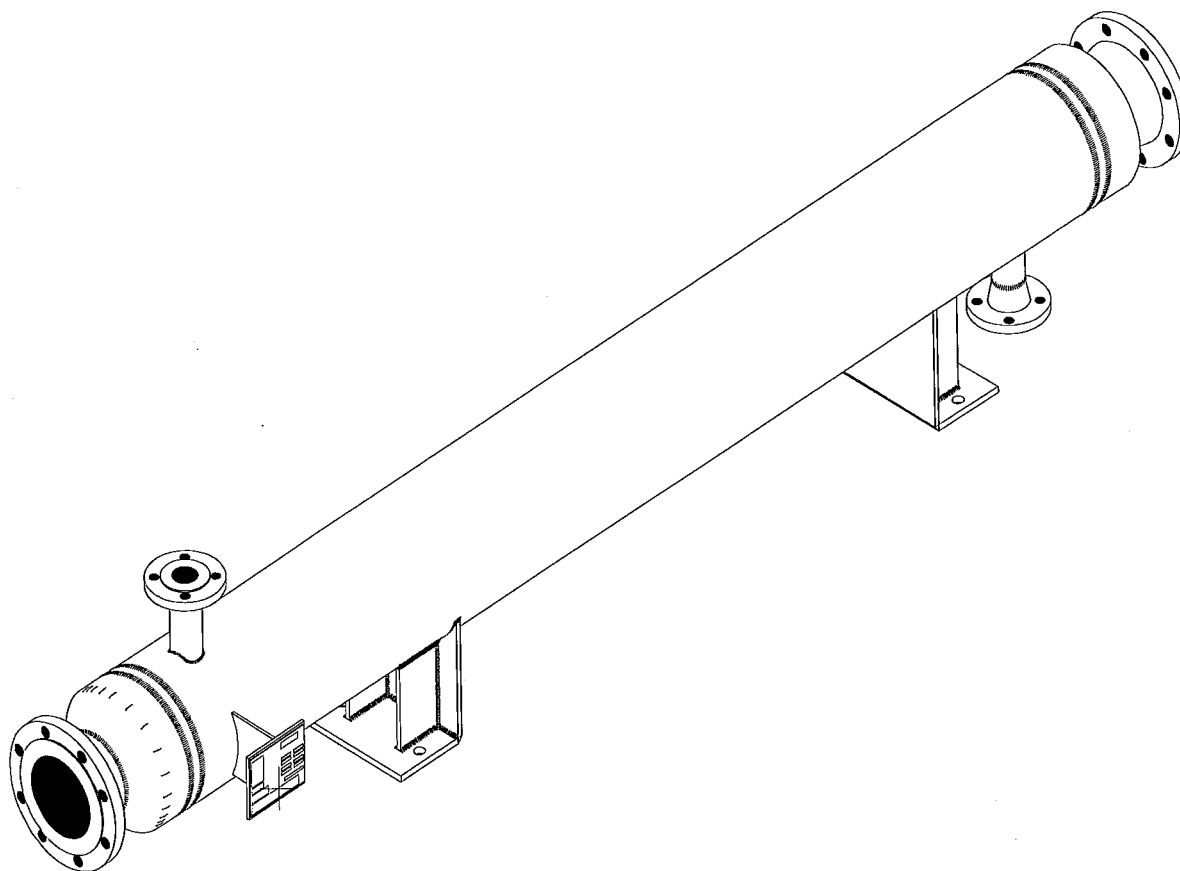

---

*Serving*  
*Petroleum, Petrochemical, Power, Food, and Industrial on Heat Transfer Equipment*

901 East Beecher Street  
Indianapolis, IN 46203 USA

**FORM U-1 MANUFACTURER'S DATA REPORT FOR PRESSURE VESSELS**  
**As Required by the Provisions of the ASME Code Rules, Section VIII, Division 1**

1. Manufactured and certified by Heat Exchanger Design, Inc. 901 E. Beecher Street, Indianapolis, IN 46203  
(Name and address of Manufacturer)
2. Manufactured for Range Fuels Soperton Plant, LLC, 11101 W 120th Ave., Suite 200, Broomfield, CO 80021  
(Name and address of Purchaser)
3. Location of installation Unknown  
(Name and address)
4. Type: Horizontal Heat Exchanger 4017C -- 4017C Rev.2 2932 2009  
(Horiz., vert., or sphere) (Tank, separator, jkt. vessel, heat exch., etc.) (Mfg's serial No.) (CRN) (Drawing No.) (Nat'l. Bd. No.) (Year built)
5. ASME Code, Section VIII, Div. 1 2007, A08 Code Case No. -- Special Service per UG-120(d) --  
Edition and Addenda (date)
- Items 6 - 11 Incl. to be completed for single wall vessels, jackets of jacketed vessels, shell of heat exchangers, or chamber of multi-chamber vessels.
6. Shell (a) No. of course(s): (3) (b) Overall length (ft & in.): 21'-6"

Course(s)			Material		Thickness		Long Joint (Cat. A)			Circum. Joint (Cat. A, B & C)			Heat Treatment	
No.	Diameter, in.	Length (ft. & in.)	Spec./Grade or Type		Nom.	Corr.	Type	Full, Spot, None	Eff.	Type	Full, Spot, None	Eff.	Temp.	Time
(2)	24" ID	7'-11"	SA-516Gr.70		.375"	.0625"	1	Full	100%	1	Full	100%	None	--
(1)	24" ID	5'-8"	SA-516Gr.70		.375"	.0625"	1	Full	100%	1	Spot	70%	None	--
--	--	--	--		--	--	--	--	--	--	--	--	--	--

7. Heads: (a) SA-516Gr.70N - 24" ID (b) SA-516Gr.70N - 14" OD impingement dome  
(Mat'l Spec. No., Grade or Type) H.T.-Time & Temp (Mat'l Spec. No., Grade or Type) H.T.-Time & Temp

	Location (Top, Bottom, Ends)	Thickness		Radius		Elliptical Ratio	Conical Apex Angle	Hemispherical Radius	Flat Diameter	Side to Pressure		Category A		
		Min.	Corr.	Crown	Knuckle					Convex	Concave	Type	Full, Spot, None	Eff.
(a)	End	.25"	.0625"	--	--	2:1	--	--	--	--	Yes	--	--	--
(b)	Top	.28"	.0625"	--	--	2:1	--	--	--	--	Yes	--	--	--

If removable, bolts used (describe other fastening) --

(Mat'l Spec. No., Grade, size, No.)

8. Type of Jacket None Jacket closure --  
(Describe as ogee & weld, bar, etc.)

If bar, give dimensions --

If bolted, describe or sketch

9. MAWP 150 -- psi at max. temp. 250 -- °F Min. design metal temp. 20 °F at 150 psi.  
(internal) (external) (internal) (external)

10. Impact test No, exempt per UG-20(f).  
(Indicate yes or no and the component(s) Impact tested)

11. Hydro., pneu., or comb. test press. 195 Proof test --  
Items 12 and 13 to be completed for tube sections.

12. Tubesheet: SA-516Gr.70N 24" 3.5" .0625" Welded  
Stationary (Mat'l Spec. No.) Dia., in. (subject to press.) Nom. thk., in. Corr. Allow., in. Attachment (welded or bolted)  
None -- -- --

- Floating (Mat'l Spec. No.) Dia., in. Nom. thk., in. Corr. Allow., in. Attachment  
13. Tubes: SA-213TP304L 5/8" .065" (325) "U"  
Mat'l Spec. No., Grade or Type O.D., in. Nom. thk., in. or gauge Number Type (Straight or U)

Items 14 - 18 Incl. to be completed for inner chambers of jacketed vessels or channels of heat exchangers.

14. Shell (a) No. of course(s): (1) (b) Overall length (ft & in.): 1'-8"

Course(s)			Material		Thickness		Long Joint (Cat. A)			Circum. Joint (Cat. A, B & C)			Heat Treatment	
No.	Diameter, in.	Length (ft. & in.)	Spec./Grade or Type		Nom.	Corr.	Type	Full, Spot, None	Eff.	Type	Full, Spot, None	Eff.	Temp.	Time
(1)	24" ID	1'-8"	SA516Gr.70N		1.25"	None	1	Full	100%	1	Spot	70%	None	--
--	--	--	--		--	--	--	--	--	--	--	--	--	--
--	--	--	--		--	--	--	--	--	--	--	--	--	--

15. Heads: (a) SA-350Gr.LF2 (b) --  
(Mat'l Spec. No., Grade or Type) H.T.-Time & Temp (Mat'l Spec. No., Grade or Type) H.T.-Time & Temp

	Location (Top, Bottom, Ends)	Thickness		Radius		Elliptical Ratio	Conical Apex Angle	Hemispherical Radius	Flat Diameter	Side to Pressure		Category A		
		Min.	Corr.	Crown	Knuckle					Convex	Concave	Type	Full, Spot, None	Eff.
(a)	End	6"	None	--	--	--	--	--	37"	Flat	Flat	--	--	--
(b)	--	--	--	--	--	--	--	--	--	--	--	--	--	--

If removable, bolts used (describe other fastening)

(28) 1 3/4"-8 x 18" long studs SA-193Gr.B7 / (56) nuts SA-194Gr.2H

16. MAWP 1650 F.V. psi at max. temp. 385 385 °F Min. design metal temp. 20 °F at 1650/F.V. psi.  
(Internal) (external) (Internal) (external)

17. Impact test No, channel body fig and flat head exempt per UCS-66(g) and remaining items per Fig. UCS-66.  
(Indicate yes or no and the component(s) impact tested)

18. Hydro., pneu., or comb. test press. 2145

Proof test --

19. Nozzles, inspection, and safety valve openings:

Purpose (Inlet, Outlet, Drain, etc.)	No.	Diameter or Size	Flange Type	Material		Nozzle Thickness		Reinforcement Material	How Attached		Location (Insp. Open)
				Nozzle	Flange	Nom.	Corr.		Nozzle	Flange	
Shell Inlet	(1)	10"	Cl.150 rfwn	SA-106Gr.B	SA-105	.375"	.0625"	Not Required	UW-16.1(c)	UW-16.1(a)	Bottom
Shell Outlet	(1)	10"	Cl.150 rfwn	SA-106Gr.B	SA-105	.365"	.0625"	Not Required	UW-16.1(c)	Fig.2-4(6)	Top
Tube Inlet	(1)	8"	Cl.900 rtjlwn	SA-105	SA-105	1.875"	None	Not Required	UW-16.1(c)	Integral	Bottom
Tube Outlet	(1)	8"	Cl.900 rtjlwn	SA-105	SA-105	1.875"	None	Not Required	UW-16.1(c)	Integral	Top
Shell Vent	(1)	1"	Cl.150 rfwn	SA-105	SA-105	.500"	.0625"	Not Required	UW-16.1(c)	Integral	Bottom
Shell Drain	(1)	1"	Cl.150 rfwn	SA-105	SA-105	.500"	.0625"	Not Required	UW-16.1(c)	Integral	Top
Relief Conn.	(1)	4"	Cl.150 rfwn	SA-106Gr.B	SA-105	.337"	.0625"	Not Required	UW-16.1(c)	Fig.2-4(6)	Top

20. Supports: Skirt No Lugs -- Legs -- Others Saddle Supports Attached Welded to shell bottom.  
(Yes or No) (No.) (No.) (Describe) (Where and How)

21. Manufacturer's Partial Data Reports properly identified and signed by Commissioned Inspectors have been furnished for the following items of the report:  
(List the name of part, item number, mfg's. name and identifying number)

Shell cylinder Serial No. 09-6596-1 and channel cylinder Serial No. 09-6596-2 manufactured by Wagner Plate Works, LLC. See attached Form U-2A's.

22. Remarks: 1) Relief valving to be supplied in customers piping. 2) No radiography performed on nozzles, 100% Eff. 3) Channel body and tube nozzle ID's, flange faces and tubesheet face have corrosion resistant weld overlay of ER316L. Channel flat head includes an applied of SA-240Gr.304L. Weld overlay and liner are not included in strength calculations. 4) Shell inlet nozzle flange attached to top of impingement dome head reported on line 7(b) which is type 1 butt welded to 14" std. wgt. SA-106B pipe reported on line 19.

### CERTIFICATE OF SHOP COMPLIANCE

We certify that the statements made in this report are correct and that all details of design, material, construction, and workmanship of this vessel conform to the ASME Code for Pressure Vessels, Section VIII, Division 1,  
U Certificate of Authorization No. 23,740 Expires 9/27 2011

Date 9/21/09

Name Heat Exchanger Design, Inc.

(Manufacturer)

Signed

(Representative)

### CERTIFICATE OF SHOP INSPECTION

I, the undersigned, holding a valid commission issued by The National Board of Boiler and Pressure Vessel Inspectors and the State or Province of IN,  
and employed by HSB CT of Hartford, CT. have inspected  
the pressure vessel described in this Manufacturer's Data Report on 9/21 2009, and state that, to the best of my knowledge and belief, the  
Manufacturer has constructed this pressure vessel in accordance with ASME Code Section VIII, Division 1. By signing this certificate neither the Inspector nor his  
employer makes any warranty, expressed or implied, concerning the pressure vessel described in this Manufacturer's Data Report. Furthermore, neither the Inspector  
nor his employer shall be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Date 9/21/09

Signed

(Authorized Inspector)

Commissions NB 10006 (A, B) IN1418

(Nat'l Board incl. endorsement, State, Province and No.)

### CERTIFICATE OF FIELD ASSEMBLY COMPLIANCE

We certify that the statements on this report are correct and that the field assembly construction of all parts of this vessel conforms with the requirements of ASME  
Code, Section VIII, Division 1,  
U Certificate of Authorization No. 23,740 Expires 20 2011

Date

Name

(Assembler)

Signed

(Representative)

### CERTIFICATE OF FIELD ASSEMBLY INSPECTION

I, the undersigned, holding a valid commission issued by The National Board of Boiler and Pressure Vessel Inspectors and the State or Province of IN,  
and employed by HSB CT of Hartford, CT. have compared the statements in this Manufacturer's Data Report with the described pressure vessel and state that parts referred to as data items  
not included in the certificate of shop inspection, have been inspected by me and to the best of my knowledge  
and belief, the Manufacturer has constructed and assembled this pressure vessel in accordance with ASME Code, Section VIII, Division 1. The described vessel  
was inspected and subjected to a hydrostatic test of 2145 psi. By signing this certificate neither the Inspector nor his employer makes any warranty,  
expressed or implied, concerning the pressure vessel described in this Manufacturer's Data Report. Furthermore, neither the Inspector nor his employer shall  
be liable in any manner for any personal injury or property damage or a loss of any kind arising from or connected with this inspection.

Date

Signed

(Authorized Inspector)

Commissions

(Nat'l Board incl. endorsement, State, Province and No.)