


THE PERFORMANCE OF 12QL147 PUMP # RR-33550-03-03

REPRESENTATIVE OF ALL THREE PUMPS ON THIS ORDER
RR-33550-03-01/02/03

GA-8318 3116-504

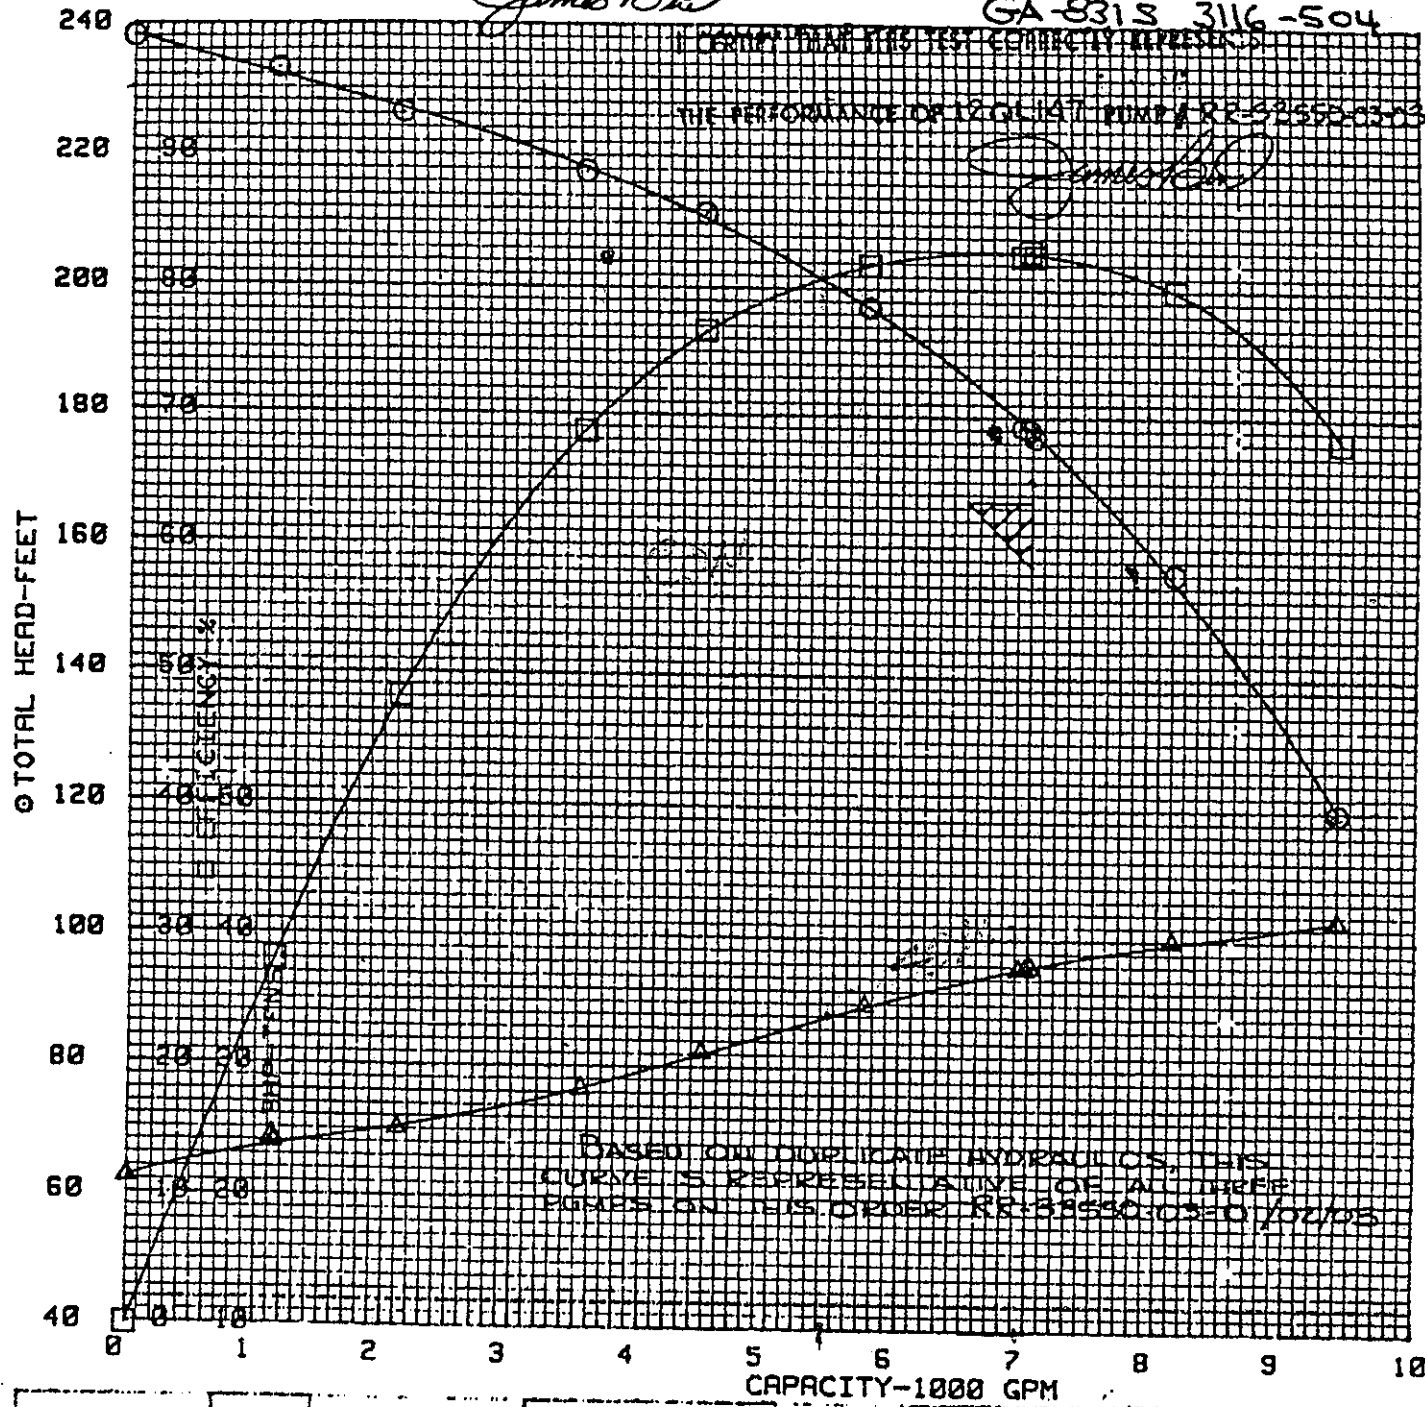

Worthington Pump Division
DRESSER Industries Inc.
PUMP TEST DATA

RPM	GPM	HD.	BHP	EFF.
1783.0	8864	188.5	384.1	82.6
1784.0	8134	157.7	485.9	80.8
1784.0	8446	121.8	422.9	80.2
1785.0	7858	179.8	385.8	82.7
1786.0	5774	188.8	355.4	81.8
1786.0	4582	214.7	318.3	78.7
1788.0	3582	221.8	289.4	80.7
1788.0	2132	238.2	257.3	48.2
1781.0	1152	237.3	245.5	28.1
1792.0	0	242.8	218.4	8.8
1785.0	7818	188.1	384.1	83.1

SP GR: 1

CASING DATA

C.I.	-	-
MATERIAL	FINISH	TONGUE

IMPELLER DATA

BRONZE	I-A	-
MATERIAL	FINISH	DISC. TIPS
VW 17393	-	14.44

PATT. NO.	COMB. NO.	DIA.
-----------	-----------	------

12QL147	1	25200	PST25200-1	10/29/85	STA	JRB	500 HP 1800 RPM POWER RDGE. FROM TORQUEMETER	12x9	1775	E-218434
PUMP	STAGES	ORDER NO.	SERIAL NO.	DATE	TEST APPROVED	TEST DRIVER	VENTURI	PLOTTED RPM	CURVE NO.	